


FLOOR REINFORCEMENT

SCALE 1:50

SOIL CONDITIONS	REINFORCEMENT, BOTH WAYS c/c 200		SLAB THICKNESS
	TOP	BOTTOM	
NORMAL	φ 10 P14 TO P20	φ 10 P14 TO P20	200mm
BLACK COTTON	φ 20 P14b TO P20b	φ 10 P14a TO P20a	350mm

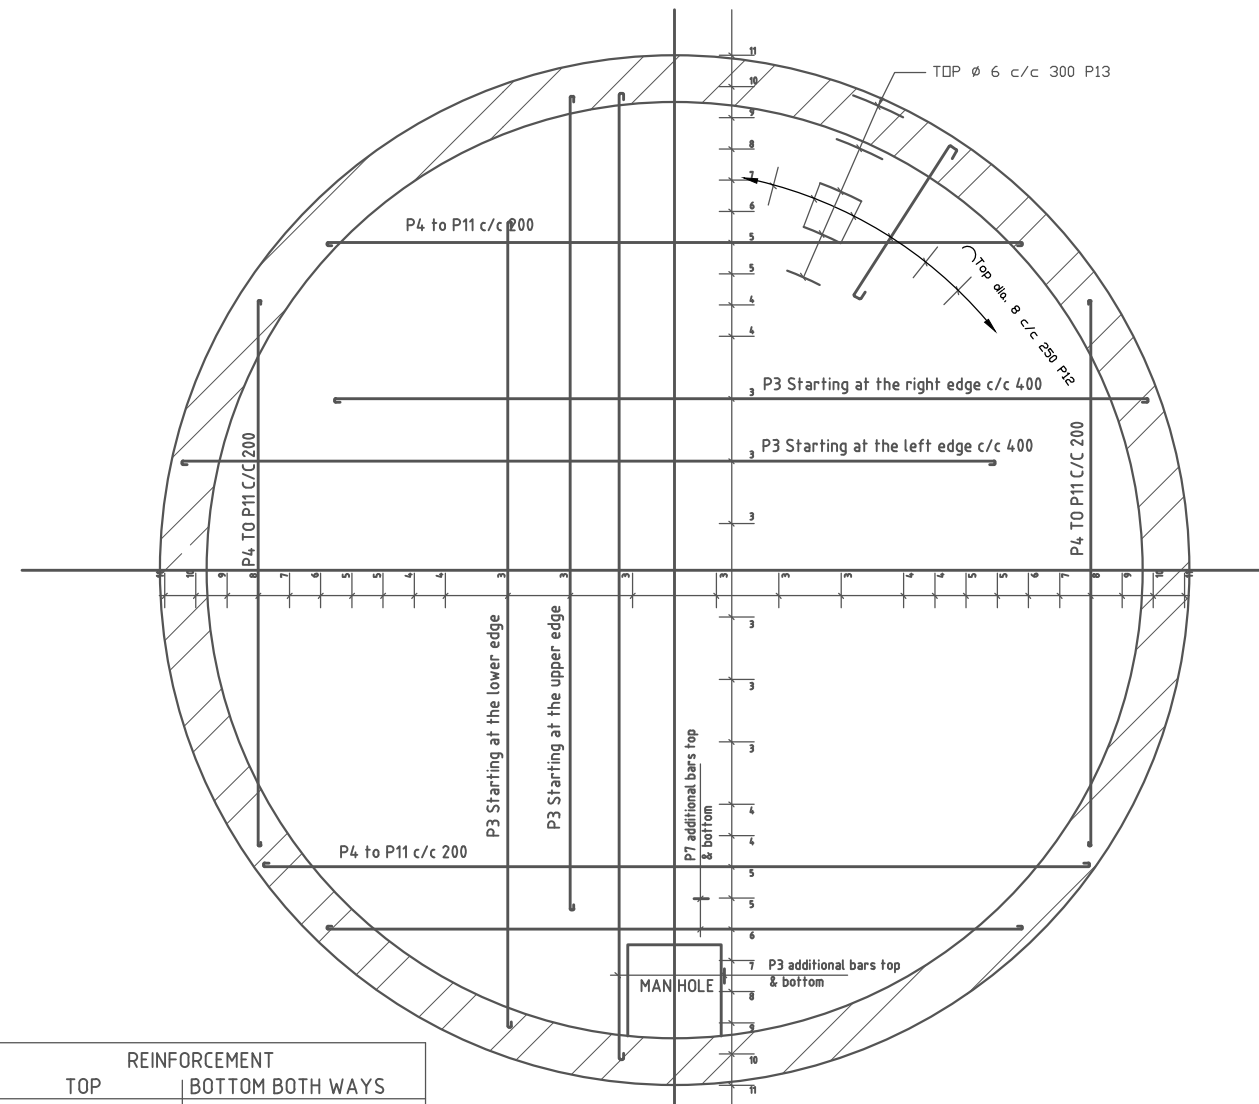

ROOF REINFORCEMENT

SCALE 1:50

REINFORCEMENT	
TOP	BOTTOM BOTH WAYS
φ 8 250 c/c radial P12	φ 16 200 c/c P3 TO P11
φ 6 300 c/c circles P13	

COUNTY GOVERNMENT OF
KERICHO



**25 M³ MASONRY STORAGE TANK
(NOTES)**

DESIGNED	G.K LANGAT	MARCH 2019	SHEET 3 OF 3
DRAWN	G.K LANGAT	MARCH 2019	SCALE: AS SHOWN
SURVEYED	G.K LANGAT	MARCH 2019	DRG. NO.
CHECKED	ENG. L.ANDREW	MARCH 2019	C.o.G
APPROVED	A.K.L	MARCH 2019	013-TYPE-084B