


FLOOR REINFORCEMENT
SCALE 1:50

SOIL CONDITIONS	REINFORCEMENT, BOTH WAYS c/c 200		SLAB THICKNESS
	TOP	BOTTOM	
NORMAL	φ 10 P14 TO P20	φ 10 P14 TO P20	200mm
BLACK COTTON	φ 20 P14b TO P20b	φ 10 P14a TO P20a	350mm

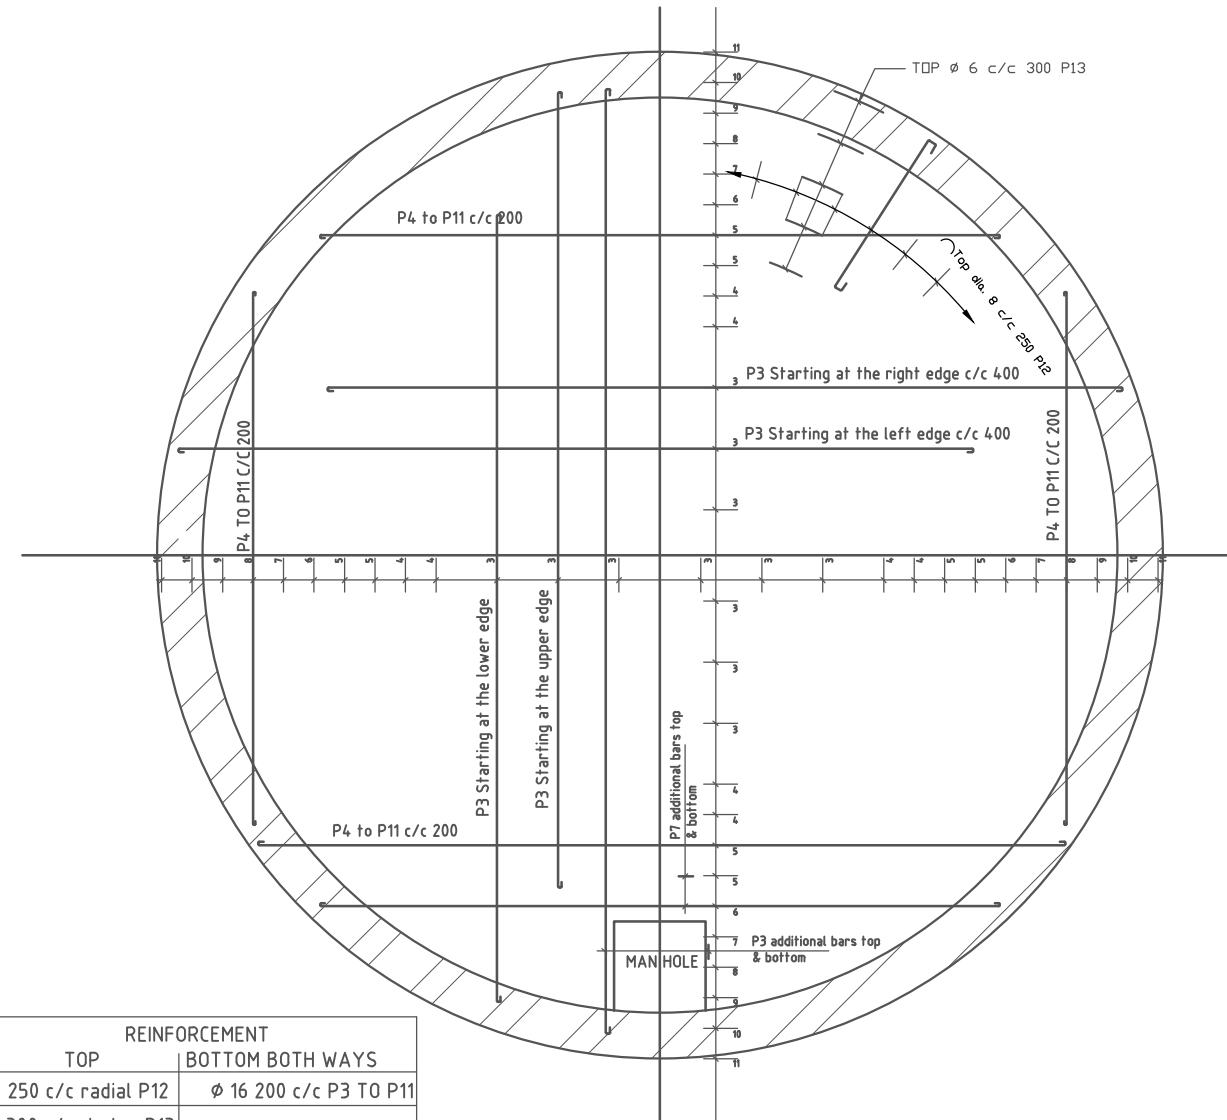

ROOF REINFORCEMENT
SCALE 1:50

REINFORCEMENT	
TOP	BOTTOM BOTH WAYS
φ 8 250 c/c radial P12	φ 16 200 c/c P3 TO P11
φ 6 300 c/c circles P13	

KERICHO COUNTY
DEPARTMENT
OF WATER



100M³ GROUND LEVEL MASONRY
STORAGE TANK (NOTES)

			SHEET 1 OF 3
DRAWN	G.K.LANGAT		SCALE: AS SHOWN
DIGITIZED	G.K.L & C.KB	FEB. 2019	DRG. NO.
CHECKED	ENG. TONU W.	FEB 2019	C.G.K
APPROVED	ENG. TONU W.	FEB 2019	013-TYPE-059